


## TECHNICAL NOTES

### Material Properties

1. The **ICD-150 (INVERTED)** is the **IRD-150** roof deck with embossments rolled into the web elements to achieve the composite interlocking capacity between the steel deck and concrete.
2. Steel deck section properties were calculated in accordance with CSA S136-07.
3. Steel conforms to ASTM A653 SS Grade 33 and A653M SS Grade 230 with Z275 (G90) and ZF75 (A25) surface coatings.
4. Concrete is based on normal density of 2300 kg/m<sup>3</sup> (145 pcf) and having a minimum compressive strength of 20 MPa (3 ksi).

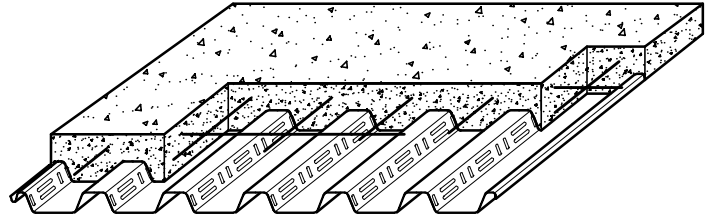

### EXAMPLE (Metric)

Determine the specified uniformly distributed live load that can be placed on the **IDEAL** inverted composite floor slab, given the following information:

#### Given:

- Steel deck thickness = 1.22 mm
- Yield strength = 230 MPa
- Normal density concrete = 2300 kg/m<sup>3</sup>
- Overall slab depth = 130 mm
- Double span, each = 2.8 m
- Specified superimposed dead load, DL = 1.70 kPa

#### Solution:

The maximum specified load in (**kPa**) from load table must be  $\geq [LL + (1.25/1.5)DL]$ ,

where

LL = specified live load

DL = specified superimposed dead load

From load table under 2.8 m span, the maximum specified load is **11.9 kPa**, therefore,  
 $11.9 \geq [LL + (1.25/1.5)1.70]$  and solving for LL,

$$LL = \underline{10.5 \text{ kPa}}$$

Since this is in the shaded area, one shore support is required at mid-span in each span.

#### Note:

**The self-weight of the steel deck and concrete slab have already been accounted for in the maximum specified uniformly distributed load given in the composite slab load table.**

### Load Tables

1. Loads are maximum specified uniformly distributed loads resulting from human occupancy and should not be used for concentrated loads. Maximum specified load from load table must be  $\geq [LL + 0.833DL]$ ;  
Where LL = specified live load;  
DL = specified dead load; 0.833 = 1.25/1.5
2. Loads greater than **10 kPa (200 psf)** are commonly the result of large **concentrated moving loads**. **In such cases, appropriate design consideration should be used by the structural engineers.**
3. The steel deck provides the positive reinforcement for the simply supported composite slab and no additional reinforcing steel is required. To control shrinkage and temperature cracking, a minimum steel wire mesh of 152 x 152 – MW9.1/MW9.1 (6 x 6 - 10/10) is recommended as per CSSBI S3-03.
4. Shoring requirements shown in shaded areas of the load table were established in accordance with CSSBI 12M-06.
5. To establish the shear-bond capacity of the **IDEAL** inverted composite slab system, laboratory tests were carried out at the Structural Testing and Research laboratory (STAR), Cambridge, Ontario in accordance with CSSBI S2-02.
6. All technical information and load tables were prepared by Dr. R.M. Schuster, Professor Emeritus of Structural Engineering, University of Waterloo, Ontario.



**Head Office**  
1418 Michael St.  
Ottawa, Ont., Canada K1B 3R2  
Tel: (613) 746-3206  
Fax: (613) 746-0445  
Wats Line: 1-800-267-0860  
E-mail: info@idealroofing.ca

**Québec Regional Sales Office**  
600 des Canetons, Suite 250  
Québec, Qc., Canada G2E 5W6  
Tel: (418) 874-0010  
Fax: (418) 874-0011  
Wats Line: 1-888-313-0010

**Toronto Manufacturing Facility**  
223 Corporation Drive  
Brampton, Ont., Canada